


\* 78" minimum for installations other than individual, field-installed meter panels. Increase the working-space height for installations greater than 66".

**Figure 5-3**  
**Semi-Flush Meter Installation**

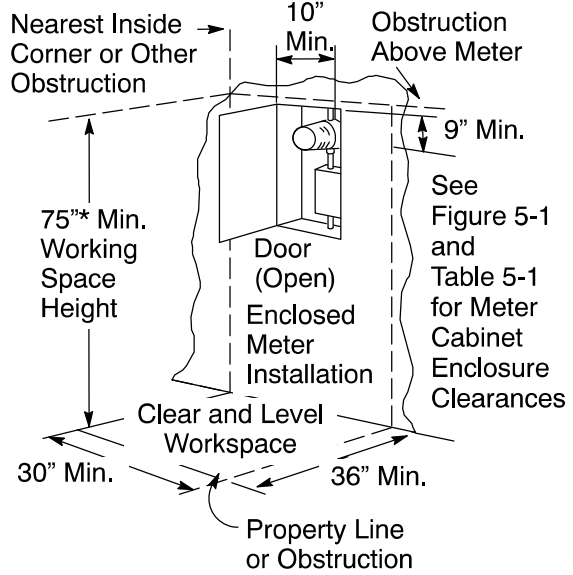

**Note:** To allow the cabinet door to open fully (90° or more), increase the 30" minimum-width dimension of the meter working space, as necessary.

**Figure 5-4**  
**Enclosed Meter Installation**